

ORIGINAL RESEARCH

Open Access

# Optimum parametric performance characterization of an irreversible gas turbine Brayton cycle

Maher M Abou Al-Sood\*, Kassem K Matrawy and Yousef M Abdel-Rahim

## Abstract

A general mathematical model is developed to specify the performance of an irreversible gas turbine Brayton cycle incorporating two-stage compressor, two-stage gas turbine, intercooler, reheater, and regenerator with irreversibilities due to finite heat transfer rates and pressure drops. Ranges of operating parameters resulting in optimum performance (i.e.,  $\eta_I \geq 38 \geq \eta_{II} \geq 60\%$ ,  $ECOP \geq 1.65$ ,  $x_{loss} \leq 0.150$  MJ/kg,  $BWR \leq 0.525$ ,  $w_{net} \geq 0.300$  MJ/kg, and  $q_{add} \leq 0.470$  MJ/kg) are determined and discussed using the Monte Carlo method. These operating ranges are minimum cycle temperature ranges between 302 and 315 K, maximum cycle temperature ranges between 1,320 and 1,360 K, maximum cycle pressure ranges between 1.449 and 2.830 MPa, and conductance of the heat exchanger ranges between 20.7 and 29.6 kW/K. Exclusive effect of each of the operating parameters on each of the performance parameters is mathematically given in a general formulation that is applicable regardless of the values of the rest of the operating parameters and under any condition of operation of the cycle.

**Keywords:** Intercooled reheat Brayton cycle; Regenerator; Turbine; Compressor; Operating parameters; Performance

## Background

First gas turbines developed in the 1930's used to have representative simple cycle efficiencies of about 17% due to low compressor and turbine efficiencies and low turbine inlet temperatures for material stress and thermal limitations. Efforts to improve these efficiencies have specifically or concurrently concentrated in three areas: (1) modifying the working cycle, (2) increasing turbine inlet temperature, and (3) enhancing the performance of cycle components. Recently, developments in material science allow using turbine inlet temperatures up to 1,500°C (i.e., general electric uses a turbine inlet temperature of 1,425°C). Also, continuous modifications of Brayton cycle to include regeneration [1,2], isothermal heat addition [3-6], intercooled compression [7,8], reheat expansion [9,10], and combined modifications [11-14] have resulted in practically doubling the cycle efficiencies. This is because intercooling and reheating result in decreasing the average temperature at which heat is added. Finally, computer-aided design and simulation studies have enabled optimization of cycle components such as compressors and turbines.

The Brayton cycle, as a model of gas turbine power plants, has been optimized for entropy generation [15,16], reversible work [17,18], power [19-22], power density [23-25], internal irreversibilities of compressors and turbines [26,27], pressure drops in heaters, coolers, and regenerators [19,23,24,28], and external irreversibilities of coupling to external heat reservoirs or heat exchangers [20].

Most of the abovementioned literature studies have been carried out to improve the performance of real gas power plants through the optimization of design and operating parameters such as compressor and turbine inlet temperatures, pressure ratios of intercooling, reheat, and conductance of heat exchangers [12,29-33]. However, most of the previously published results found in the open literature are typically specific and valid only for the condition and parameter values taken into consideration in these studies. This means that according to the authors' knowledge, there is no general optimized work that has been done before. Therefore, and for the sake of generalized tackling of this issue, the main objective of the present study of an irreversible regenerative intercooled reheat gas turbine Brayton cycle is to identify the ranges of all design and operating parameters for optimized performance. The design and operating parameters include inlet temperatures to compressors and turbines and pressure ratios of

\* Correspondence: m\_aboualsood@hotmail.com  
Department of Mechanical Engineering, Assiut University, Assiut 71516, Egypt

intercooler and reheater. The performance parameters include the first and second law efficiencies, ecological coefficient of performance, back work ratio, exergy losses, network, and heat added.

**Methods**

**Mathematical model**

Consider a constant mass flow rate,  $\dot{m}$ , of air, as an ideal gas passing through the gas turbine cycle illustrated in Figures 1 and 2. The cycle can be characterized as follows:

- a) Air is compressed from state 1 to state 4 by two non-isentropic low pressure (LP) and high pressure (HP) compressors with efficiencies,  $\eta_{c12}$  and  $\eta_{c34}$ , and a non-isobaric counter-flow intercooler with effectiveness,  $\epsilon_{int}$ . The inlet temperature to the HP compressor is 5% higher than that of the LP compressor. The describing equations for these processes (e.g., [34,35]) are as follows:

$$\eta_{c12} = \frac{w_{c12s}}{w_{c12}} = \frac{h_{2s} - h_1}{h_2 - h_1} \tag{1}$$

$$\eta_{c34} = \frac{w_{c34s}}{w_{c34}} = \frac{h_{4s} - h_3}{h_4 - h_3} \tag{2}$$

$$\epsilon_{int} = \frac{\dot{Q}_{23}}{\dot{Q}_{int\ max}} = \frac{(UA)_{int}(\Delta T_{LM})_{int}}{\dot{Q}_{int\ max}} = \frac{\dot{Q}_{23}}{\min(\dot{C}_w, \dot{C}_{23}) \times (T_2 - T_{C2})} \tag{3}$$

Quantities  $\dot{Q}_{23}$ ,  $\dot{C}_w$ , and  $\dot{C}_{23}$  represent the rate of heat release and heat capacity rates for cooling fluid

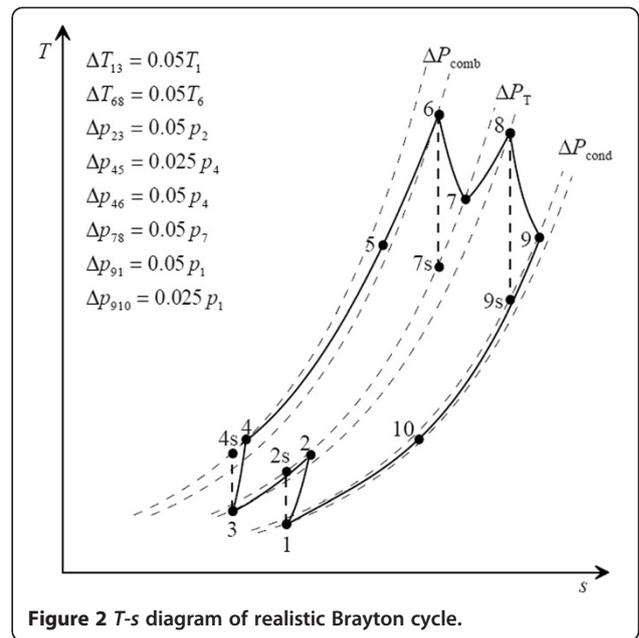


Figure 2 T-s diagram of realistic Brayton cycle.

and air, respectively. The intercooler logarithmic mean temperature difference  $(\Delta T_{LM})_{int}$  is defined as follows:

$$(\Delta T_{LM})_{int} = \frac{(T_2 - T_{C3}) - (T_3 - T_{C2})}{\ln((T_2 - T_{C3}) / (T_3 - T_{C2}))} \tag{4}$$

- b) Air is preheated from state 4 to state 5 in a regenerative counter-flow heat exchanger (that will be discussed later in the heat rejection process) and then heated up to a maximum temperature,  $T_6$ , by a counter-flow heat exchanger having a rate of heat

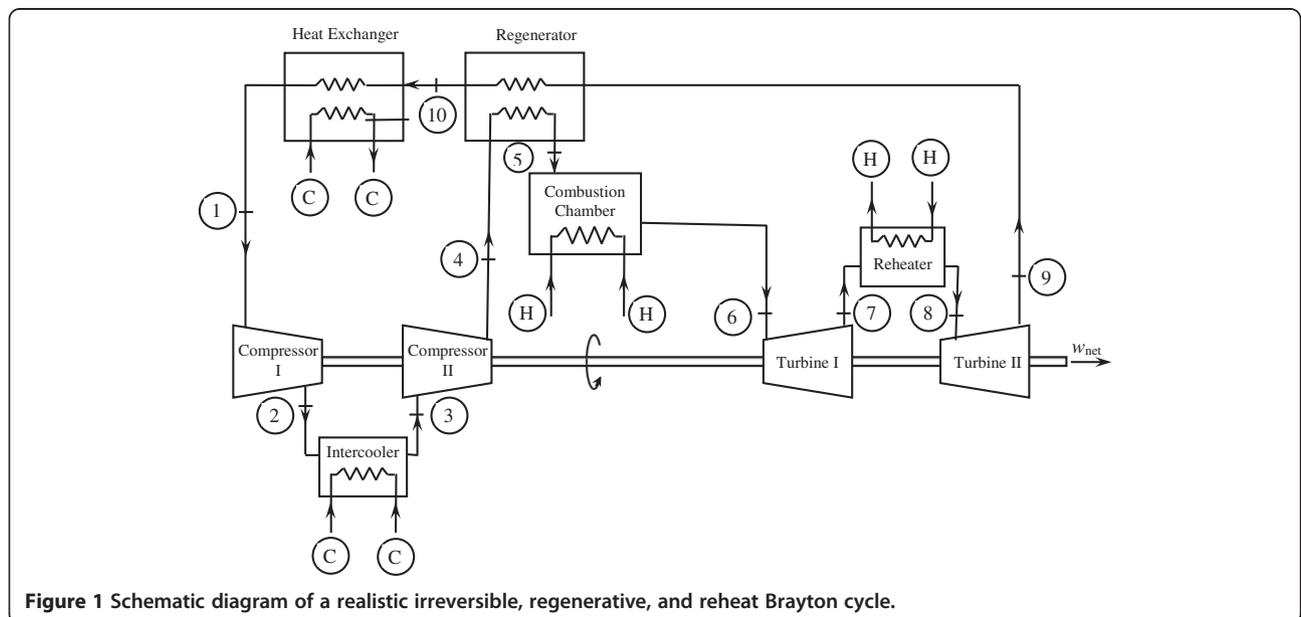


Figure 1 Schematic diagram of a realistic irreversible, regenerative, and reheat Brayton cycle.

addition  $\dot{Q}_{56}$ , an effectiveness  $\varepsilon_{\text{add}}$ , and a logarithmic mean temperature difference  $(\Delta T_{\text{LM}})_{\text{add}}$  defined as follows:

$$\varepsilon_{\text{add}} = \frac{\dot{Q}_{56}}{\dot{Q}_{\text{add max}}} = \frac{(UA)_{\text{add}}(\Delta T_{\text{LM}})_{\text{add}}}{\dot{Q}_{\text{add max}}} \quad (5)$$

$$= \frac{\dot{Q}_{56}}{\min(\dot{C}_W, \dot{C}_{56}) \times (T_5 - T_{H5})} \quad (5)$$

$$(\Delta T_{\text{LM}})_{\text{add}} = \frac{(T_5 - T_{H6}) - (T_6 - T_{H5})}{\ln((T_5 - T_{H6}) / (T_6 - T_{H5}))} \quad (6)$$

c) Air is expanded from state 6 to final state 9 by two non-isentropic LP and HP turbines with efficiencies  $\eta_{t67}$  and  $\eta_{t89}$  and one non-isobaric reheater having a rate of heat added, an effectiveness, and a logarithmic mean temperature difference as  $\dot{Q}_{78}$ ,  $\varepsilon_{\text{reh}}$ , and  $(\Delta T_{\text{LM}})_{\text{reh}}$ . The inlet temperature to LP turbine is 5% lower than that of the HP turbine. The governing equations for these processes are as follows:

$$\eta_{t67} = \frac{w_{t67}}{w_{t67s}} = \frac{h_6 - h_7}{h_6 - h_{7s}} \quad (7)$$

$$\eta_{t89} = \frac{w_{t89}}{w_{t89s}} = \frac{h_8 - h_9}{h_8 - h_{9s}} \quad (8)$$

$$\varepsilon_{\text{reh}} = \frac{\dot{Q}_{78}}{\dot{Q}_{\text{reh max}}} = \frac{(UA)_{\text{reh}}(\Delta T_{\text{LM}})_{\text{reh}}}{\dot{Q}_{\text{reh max}}} \quad (9)$$

$$= \frac{\dot{Q}_{78}}{\min(\dot{C}_H, \dot{C}_{78}) \times (T_{H7} - T_7)}$$

$$(\Delta T_{\text{LM}})_{\text{reh}} = \frac{(T_{H7} - T_8) - (T_{H8} - T_7)}{\ln((T_{H7} - T_8) / (T_{H8} - T_7))} \quad (10)$$

d) In the heat rejection process 9 to 1 between the exit of HP turbine and inlet of LP compressor, air is firstly cooled in the regenerator (with rate of heat added, effectiveness, and logarithmic mean temperature difference of  $\dot{Q}_{45}$ ,  $\varepsilon_{\text{reg}}$ , and  $(\Delta T_{\text{LM}})_{\text{reg}}$ , respectively) and finally cooled to state 1 in a counter-flow heat exchanger of parameters  $\dot{Q}_{101}$ ,  $\varepsilon_{\text{rej}}$ , and  $(\Delta T_{\text{LM}})_{\text{rej}}$ . The governing equations are as follows:

$$\varepsilon_{\text{reg}} = \frac{\dot{Q}_{45}}{\dot{Q}_{\text{reg max}}} = \frac{(UA)_{\text{reg}}(\Delta T_{\text{LM}})_{\text{reg}}}{\dot{Q}_{\text{reg max}}} \quad (11)$$

$$= \frac{\dot{Q}_{45}}{\min(\dot{C}_{45}, \dot{C}_{910}) \times (T_9 - T_4)}$$

$$(\Delta T_{\text{LM}})_{\text{reg}} = \frac{(T_9 - T_5) - (T_{10} - T_4)}{\ln((T_9 - T_5) / (T_{10} - T_4))} \quad (12)$$

$$\varepsilon_{\text{rej}} = \frac{\dot{Q}_{101}}{\dot{Q}_{\text{rej max}}} = \frac{(UA)_{\text{rej}}(\Delta T_{\text{LM}})_{\text{rej}}}{\dot{Q}_{\text{bur max}}} \quad (13)$$

$$= \frac{\dot{Q}_{101}}{\min(\dot{C}_W, \dot{C}_{101}) \times (T_{10} - T_{C10})}$$

$$(\Delta T_{\text{LM}})_{\text{rej}} = \frac{(T_{10} - T_{C1}) - (T_1 - T_{C10})}{\ln((T_{10} - T_{C1}) / (T_1 - T_{C10}))} \quad (14)$$

e) The abovementioned heat exchangers (i.e., intercooler, regenerator, high temperature heat addition, reheater, and low temperature heat rejection) are of counter-flow types, and their effectiveness can be calculated (e.g., [35]) as follows:

$$\varepsilon_i = \frac{1 - \exp[-NTU(1 - C^*)]}{1 - C^* \exp[-NTU(1 - C^*)]}, \quad (15)$$

$i = \text{int, reg, add, reh, rej}$

where  $C^*$  is the ratio ( $C^* = \min(\dot{C}_{\text{cold}}, \dot{C}_{\text{hot}}) / \max(\dot{C}_{\text{cold}}, \dot{C}_{\text{hot}})$ ) and NTU is the number of transfer unit ( $NTU = UA / \min(\dot{C}_{\text{cold}}, \dot{C}_{\text{hot}})$ ).

#### Cycle performance parameters

Heat added to the system along processes 5 to 6 and 7 to 8 and heat rejected from system through processes 10 to 1 and 2 to 3 are given in terms of enthalpy as follows:

$$\dot{Q}_{\text{add}} = \dot{m}[(h_6 - h_5) + (h_8 - h_7)] \quad (16)$$

$$\dot{Q}_{\text{rej}} = \dot{m}[(h_{10} - h_1) + (h_2 - h_3)] \quad (17)$$

where  $h_6 > h_8$  because  $T_6 > T_8$  (assuming that  $\Delta T_{86} = T_6 - T_8 = 0.05 T_6$ ) and also  $h_3 > h_1$  because  $T_3 > T_1$  (assuming that  $\Delta T_{13} = T_3 - T_1 = 0.05 T_1$ ).

The power produced by both LP and HP turbines ( $\dot{W}_t$ ) is partially consumed by both LP and HP compressors ( $\dot{W}_c$ ), and the remaining power is the net power ( $\dot{W}_{\text{net}}$ ) as follows:

$$\dot{W}_t = \dot{m}[(h_6 - h_7) + (h_8 - h_9)] \quad (18)$$

$$\dot{W}_c = \dot{m}[(h_2 - h_1) + (h_4 - h_3)] \quad (19)$$

$$\dot{W}_{\text{net}} = \dot{W}_t - \dot{W}_c \quad (20)$$

The back work ratio (BWR) and first and second law thermal efficiencies ( $\eta_I, \eta_{II}$ ) of the cycle are as follows:

$$\text{BWR} = \frac{\dot{W}_c}{\dot{W}_t} \quad (21)$$

$$\eta_I = \frac{\dot{W}_{\text{net}}}{\dot{Q}_{\text{add}}} = 1 - \frac{\dot{Q}_{\text{rej}}}{\dot{Q}_{\text{add}}} \quad (22)$$

$$\eta_{II} = \frac{\dot{W}_{\text{net}}}{\dot{W}_{\text{net,rev}}} = \frac{\dot{W}_{\text{net}}}{\dot{W}_{\text{net}} + \dot{X}_{\text{dest}}} \quad (23)$$

where  $\dot{X}_{\text{dest}}$  is the rate of exergy destruction defined,

with respect to the dead state temperature  $T_0$  as follows:

$$\begin{aligned} \dot{X}_{\text{dest}} = T_0(\Delta \dot{S}_{12} + \Delta \dot{S}_{23-C2C3} + \Delta \dot{S}_{34} + \Delta \dot{S}_{45-910} \\ + \Delta \dot{S}_{56-H5H6} + \Delta \dot{S}_{67} + \Delta \dot{S}_{78-H7H8} + \Delta \dot{S}_{89} \\ + \Delta \dot{S}_{101-C10C1}) \end{aligned} \quad (24)$$

where the above entropy changes are calculated according to [34], taking into consideration the temperature-dependent specific heats.

For the sake of ecological performance of the cycle, and its effect on environment, the following ecological coefficient of performance (ECOP), as was previously introduced by [36,37], is defined as the power output per unit loss rate of availability as follows:


$$\text{ECOP} = \frac{\dot{W}_{\text{net}}}{\dot{X}_{\text{loss}}} \quad (25)$$

### Solution procedure

The above set of equations represents complete thermodynamic modeling of the cycle, whose solution gives the cycle performance as dependent on its controlling parameters. Following conventionally reported methods of varying one or two of the controlling parameters at a time while keeping the rest of the constants will produce some specific performance results that will be valid only for those specific variation cases and cannot be of general practical applicability. Besides, these conventional solution methods can result in localized optimized


**Table 1** Surveyed ranges and accepted ranges of the cycle controlling parameters

Cycle controlling parameter	Surveyed range	Accepted range by MCM
$T_1$ entering LP compressor, (K)	300 to 450	300 to 448
$P_1$ entering to LP compressor, (kPa)	100 to 500	100 to 499
$T_6$ entering HP turbine, (K)	800 to 1500	973 to 1,483
LP compressor pressure ratios $r_{p12}$	1.2 to 5.4	1.281 to 5.393
HP compressor pressure ratios $r_{p34}$	1.2 to 5.4	1.359 to 5.393
HP turbine pressure ratio $r_{p67}$	1.2 to 5.4	1.353 to 5.397
$\eta_{c12}$ of LP compressor	0.7 to 0.9	0.7024 to 0.8995
$\eta_{c34}$ of LP compressor	0.7 to 0.9	0.7002 to 0.9000
$\eta_{t67}$ of HP turbine	0.7 to 0.9	0.7000 to 0.8998
$\eta_{t89}$ of LP turbine	0.7 to 0.9	0.7002 to 0.8994
$\epsilon_{\text{int}}$ of intercooler	0.7 to 0.95	0.7000 to 0.9500
$\epsilon_{\text{reg}}$ of regenerator	0.7 to 0.95	0.7012 to 0.9496
$\epsilon_{\text{reh}}$ of reheater	0.7 to 0.95	0.7010 to 0.9490
$\epsilon_{\text{bur}}$ of high temperature heat addition	0.7 to 0.95	0.7010 to 0.9496
$\epsilon_{\text{rej}}$ of low temperature heat rejection	0.7 to 0.95	0.7003 to 0.9495

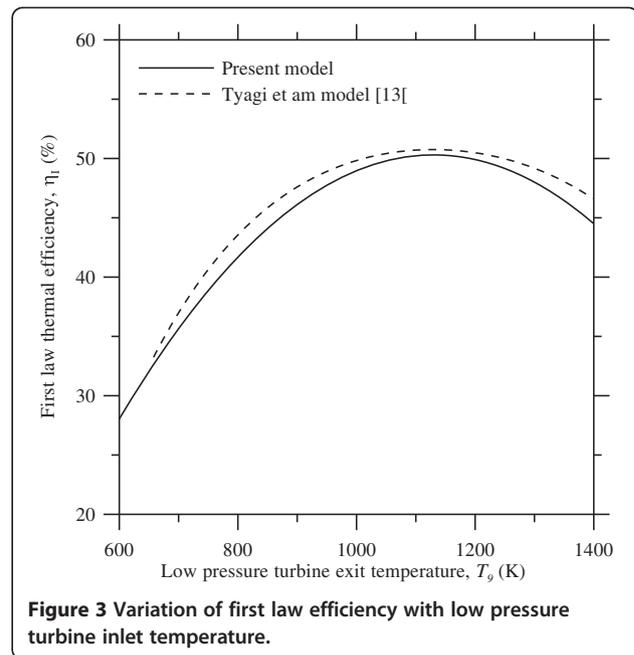

**Figure 3** Variation of first law efficiency with low pressure turbine inlet temperature.

performance values that are dependent on the specific values selected for the controlling parameters. To overcome these two issues (i.e., the generalization of the study and the global optimization), the present paper has adapted the Monte Carlo methodology (MCM) that concurrently searches the variation ranges of all controlling parameters at the same time to optimize the cycle performance over the whole domain of variations of all cycle controlling parameters.

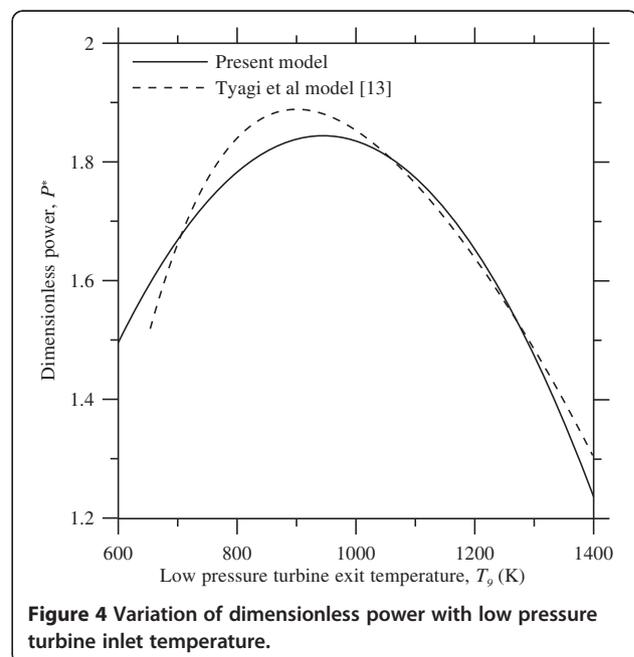

**Figure 4** Variation of dimensionless power with low pressure turbine inlet temperature.

### MCM optimization technique

The procedure of utilizing the MCM technique can be summarized as follows: (1) selection of the design and operating controlling parameters of the cycle, (2) selection of their practical variation ranges, (3) selection of the performance parameters sought to be optimized, (4) setting an acceptance-rejection criterion for the resulting performance values, (5) random selection of one complete set of values of all the controlling parameters within their variation ranges, (6) solution of the model equations (i.e., Equations 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25) for cycle performance to

get a complete set of results based on the randomly selected set of controlling parameters, (7) applying the acceptance-rejection criterion to discard the unwanted performance values and to record the rest, and (8) repeating the above steps for another random selection of another complete set of values for the controlling parameters. The above eight steps are discussed as follows:

The design and operating parameters are as follows: inlet temperature and pressure to LP compressor  $T_1, P_1$ ; maximum temperature  $T_6$  entering HP turbine; pressure ratios  $r_{p12}$  and  $r_{p34}$  of LP and HP compressors; pressure ratio,  $r_{p67}$  of HP turbine; compressors and turbine

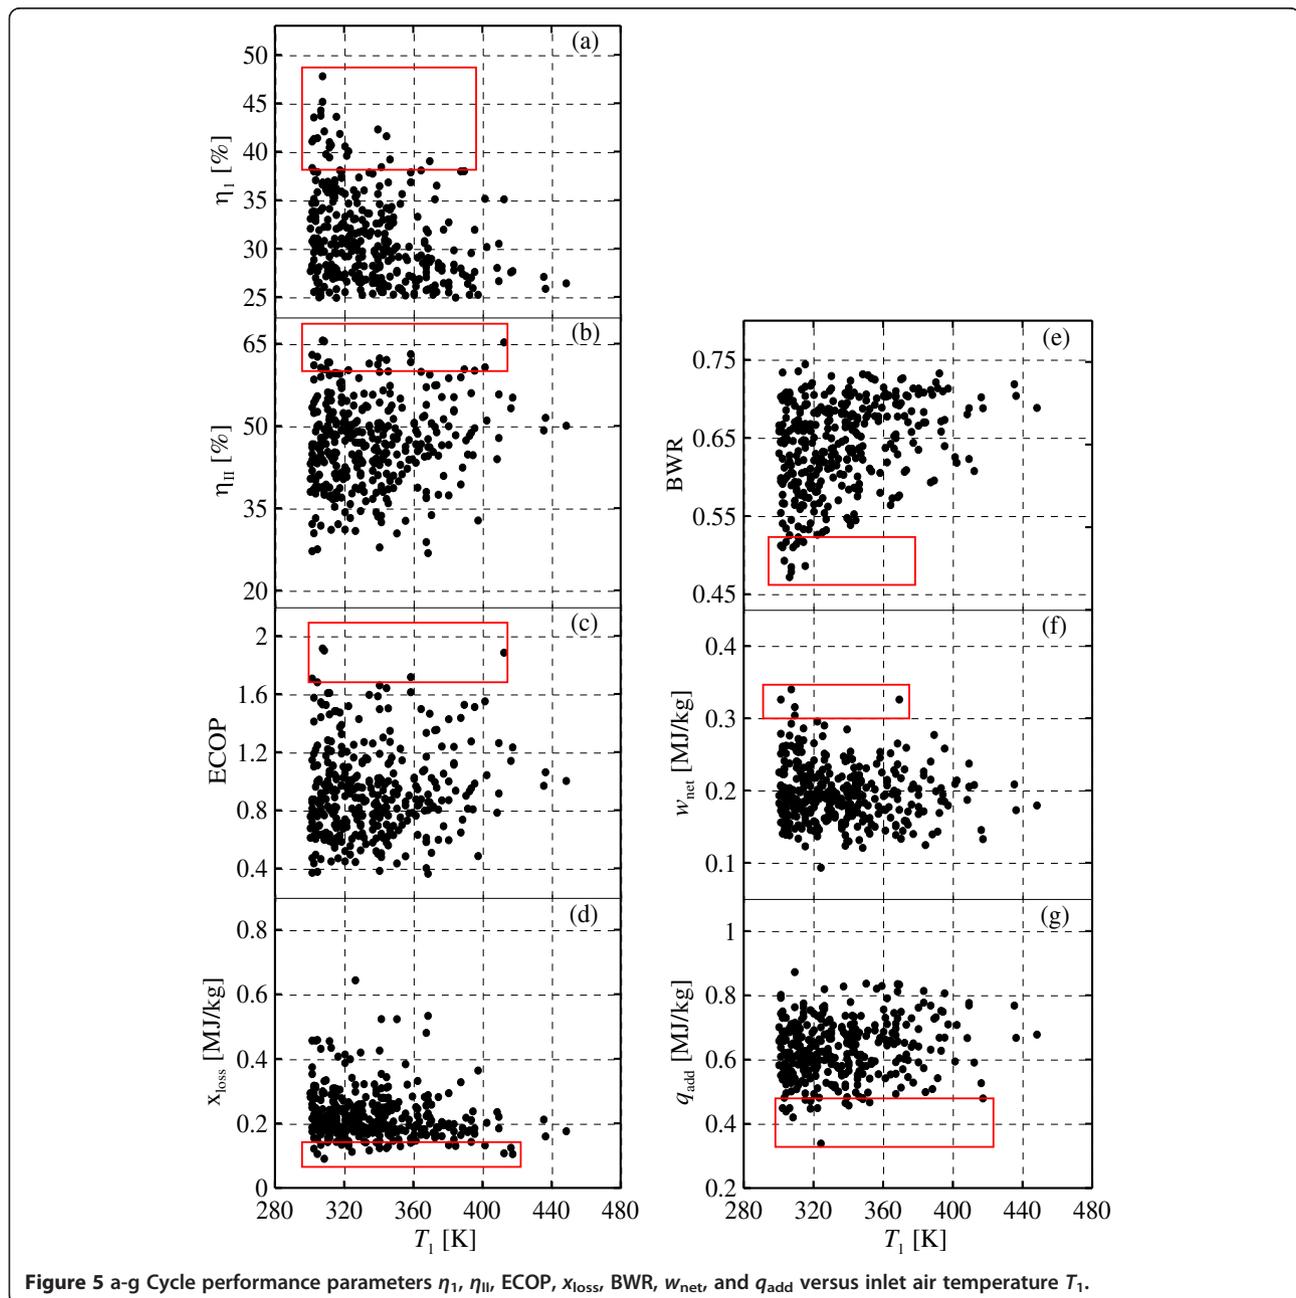



Figure 5 a-g Cycle performance parameters  $\eta_1$ ,  $\eta_{lr}$ , ECOP,  $x_{lossr}$ , BWR,  $w_{net}$  and  $q_{add}$  versus inlet air temperature  $T_1$ .

**Table 2 Optimized performance parameters with their respected ranges of controlling parameters**

	$\eta_I \geq 38\%$	$\eta_{II} \geq 60\%$	ECOP $\geq 1.65$	$x_{loss} \leq 0.150$ [MJ/kg]	BWR $\leq 0.525$	$w_{net} \geq 0.300$ [MJ/kg]	$q_{add} \leq 0.470$ [MJ/kg]
Design and performance parameters							
$T_1$ , K	301 to 389	301 to 412	301 to 412	302 to 417	301 to 315	301 to 369	302 to 352
$T_6$ , K	1,220 to 1,480	1,200 to 1,480	1,220 to 1,480	1,000 to 1,420	1,220 to 1,480	1,340 to 1,480	1,000 to 1,360
$P_4$ , kPa	750 to 7,570	750 to 7,570	864 to 4,490	750 to 4,490	864 to 4,030	1,440 to 7,570	864 to 2,830
UA, kW/K	13.6 to 37.0	16.8 to 37.0	20.7 to 34.7	14.8 to 37	14.2 to 34.7	16.6 to 29.6	13.8 to 34.7
Optimum ranges of performance parameters that are achieved by ranges of operating parameters shown above							
$\eta_I$	38 to 48	32 to 48	35 to 48	25 to 44	35 to 48	36 to 48	27 to 44
$\eta_{II}$	33 to 66	60 to 66	63 to 66	45 to 66	39 to 66	48 to 66	37 to 66
ECOP	1.54 to 1.92	1.56 to 1.92	1.69 to 1.92	1.01 to 1.91	0.79 to 1.92	1.53 to 1.92	0.98 to 1.91
$x_{loss}$ , MJ/kg	0.093 to 0.525	0.093 to 0.199	0.093 to 0.191	0.093 to 0.150	0.093 to 0.356	0.177 to 0.337	0.093 to 0.248
BWR	0.473 to 0.600	0.473 to 0.640	0.479 to 0.608	0.487 to 0.708	0.473 to 0.523	0.479 to 0.577	0.511 to 0.690
$w_{net}$ , MJ/kg	0.178 to 0.341	0.178 to 0.341	0.178 to 0.341	0.093 to 0.246	0.178 to 0.341	0.305 to 0.341	0.093 to 0.197
$q_{add}$ , MJ/kg	0.422 to 0.835	0.422 to 0.808	0.422 to 0.794	0.340 to 0.674	0.422 to 0.803	0.711 to 0.874	0.340 to 0.469

efficiencies  $\eta_{c12}$ ,  $\eta_{c34}$ ,  $\eta_{t67}$ , and  $\eta_{t89}$ ; and effectiveness of intercooler, regenerator, heat addition, reheater, and heat rejection  $\varepsilon_{int}$ ,  $\varepsilon_{reg}$ ,  $\varepsilon_{add}$ ,  $\varepsilon_{reh}$ , and  $\varepsilon_{rej}$ , respectively. To reflect the commonly used realistic literature values, survey ranges of the controlling parameters are selected as shown in Table 1. The acceptable-rejection criteria used to disregard non-realistic performance values includes many conditional terms such as (and not limited to) follows: rejection of calculations based on violation of the second law of thermodynamics, exergy loss is negative, negative values of cycle efficiency, negative values of network, efficiencies higher than unity, unrealistic ratio

of specific volumes of the two compressors, unrealistic ratio of the works of the two turbines,...etc. Based on random independent selections of values of the controlling parameters within their variation ranges, 5,000 complete calculation sets of cycle performance evaluation have been executed. Applying the acceptable-rejection criterion to these 5,000 sets of calculations has resulted on accepting only 345. The surveyed ranges of values of the controlling parameters given in the first column of Table 1 have been readjusted into acceptable ranges as shown in the second column in the same table. The results are discussed below.

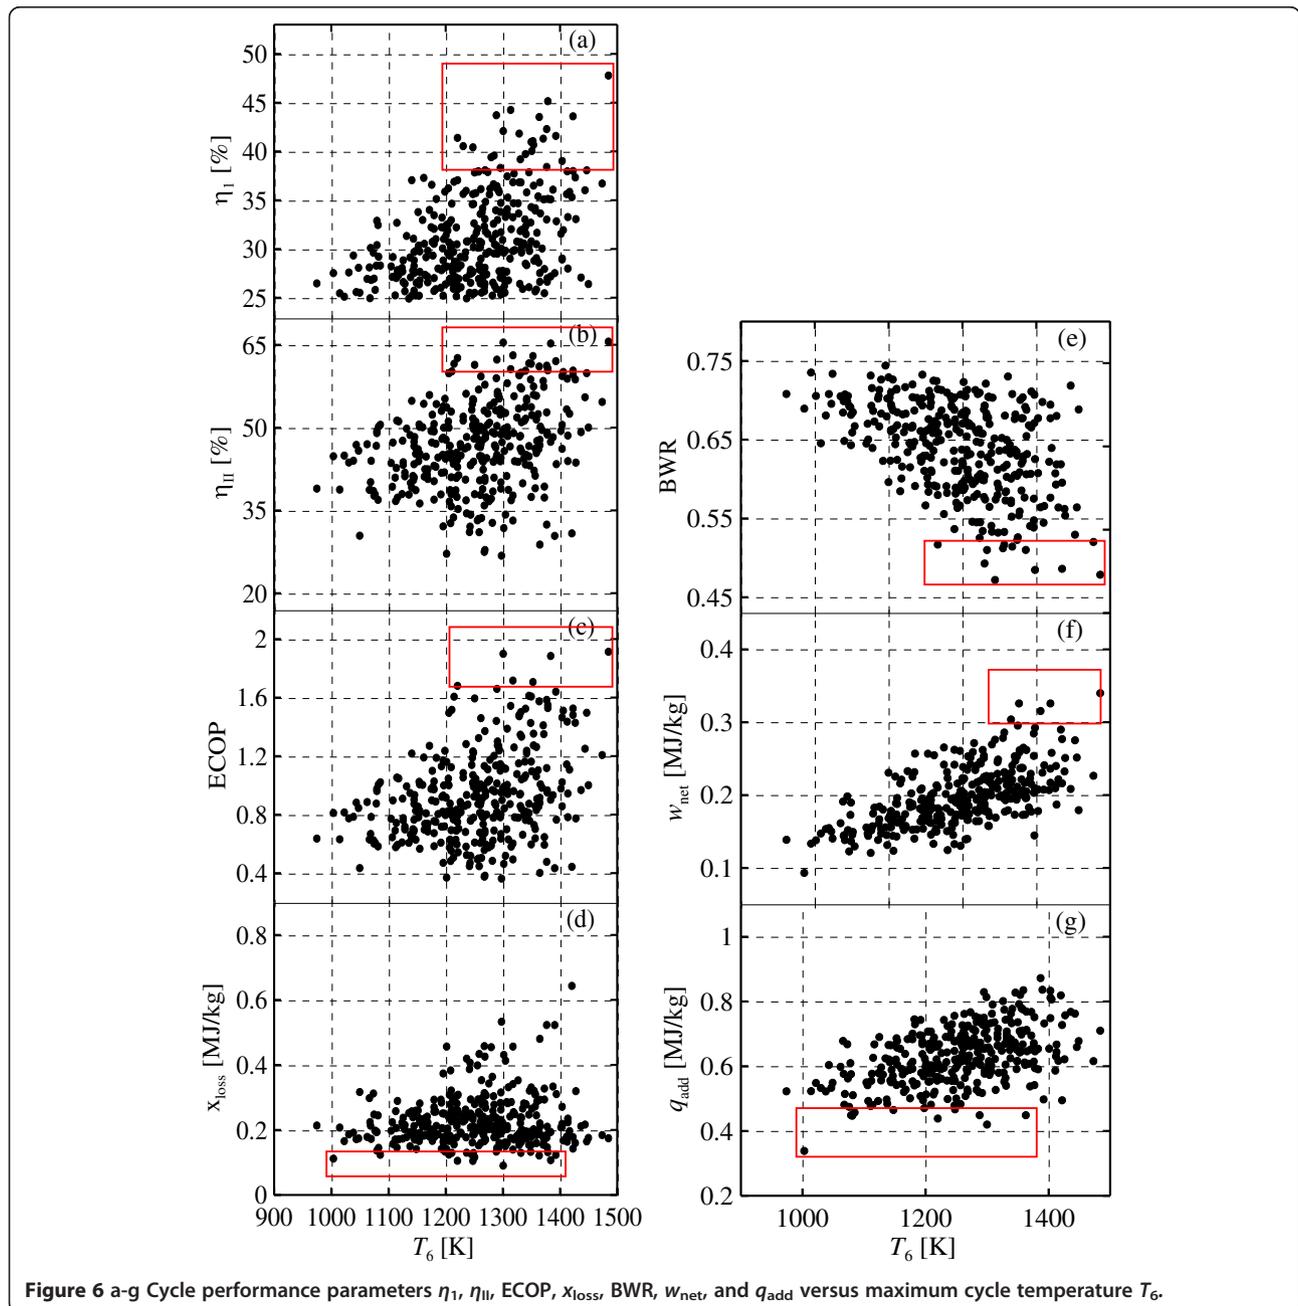

## Results and discussions

### Validation of the present model

The operating parameters of the present model have been modified to agree with those employed in the theoretical model of Tyagi et al. [13]. Variations of first law efficiency and dimensionless power output with the low pressure turbine exit temperature for the present model and its comparison of Tyagi et al. [13] are illustrated in Figures 3 and 4, respectively. Comparisons show slight deviations that could be attributed to the pressure drop employed in the present model and neglected in Tyagi et al. model.

### Sensitivity analysis

The dependency of the performance parameters on the controlling parameters are displayed below as dependents,  $\eta_I$ ,  $\eta_{II}$ , BWR, ECOP,  $x_{loss}$ ,  $w_{net}$ , and  $q_{add}$ , and independents,  $T_1$ ,  $T_6$ ,  $P_4$ , and conductance of the whole cycle (i.e., summation of heat transfer coefficient-area product for all heat transfer units) UA. The shown figures display the 345 accepted results plotted as scattered points to relate the performance parameters to the controlling parameters. Each point on any of these figures represents a complete set of accepted cycle calculation, with controlling parameter values that lie within their variation ranges. Optimal

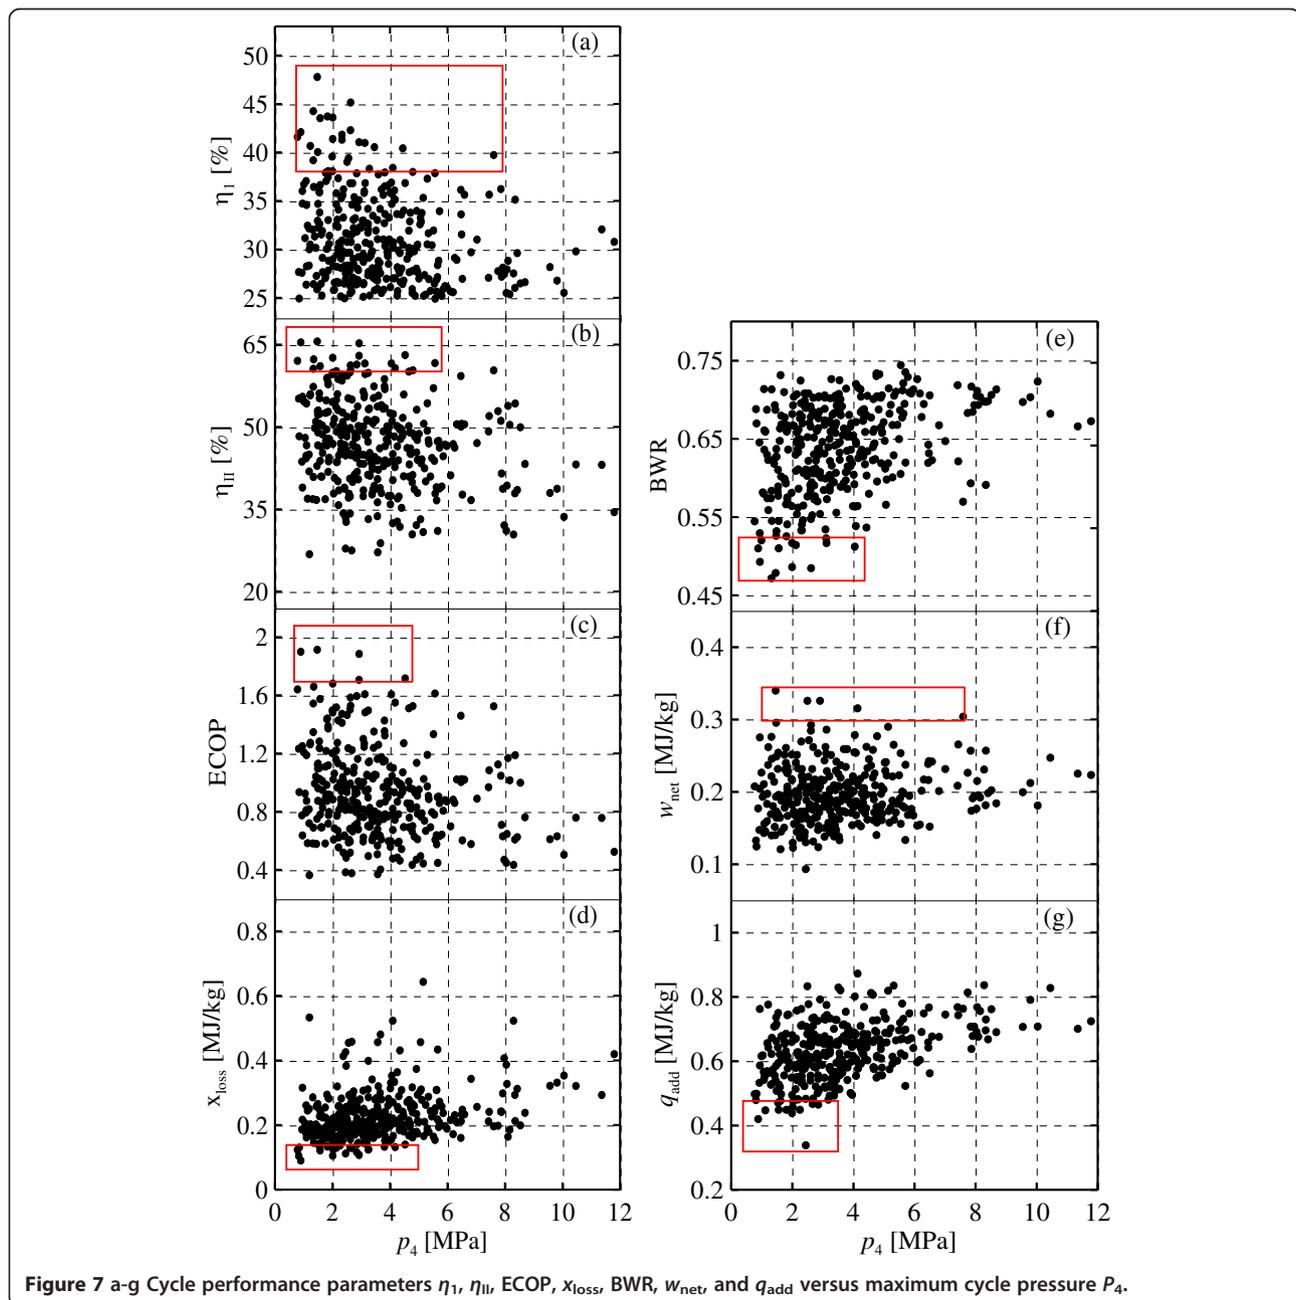



Figure 7 a-g Cycle performance parameters  $\eta_I$ ,  $\eta_{II}$ , ECOP,  $x_{loss}$ , BWR,  $w_{net}$ , and  $q_{add}$  versus maximum cycle pressure  $P_4$ .

performance values and the required operating parameter ranges are discussed in the following sections.

**Sensitivity of cycle performance to lowest cycle temperature  $T_1$**

Figure 5a,b,c,d,e,f,g shows the dependency of cycle performance on  $T_1$  at values of other controlling parameters that lie within their variation ranges in Table 1. Values of  $\eta_I$  in Figure 5a is very sensitive to  $T_1$  where it exhibits a steep decrease with  $T_1$ , where its optimum values  $>38\%$  that lie in the  $T_1$  range of about 301 to 389 K, regardless

of the values of all other controlling parameters. This signifies that, outside this  $T_1$  range, no modifications of other design or operating parameters can enhance the values of  $\eta_I$  beyond 38%. As expected, the lower the value of  $T_1$ , the higher is the value of  $\eta_I$ , with its optimum value decrease from about 48% to about 38% within this 301 to 389 K range. Figure 5b,c,d,e,f,g shows that the abovementioned range of  $T_1$  results in optimum  $\eta_{II}$  in the range 33% to 66%, optimum ECOP within 1.56 to 1.92, optimum  $x_{loss}$  within 0.093 to 0.525 MJ/kg, optimum BWR within 0.473 to 0.6, optimum  $w_{net}$  within 0.178 to

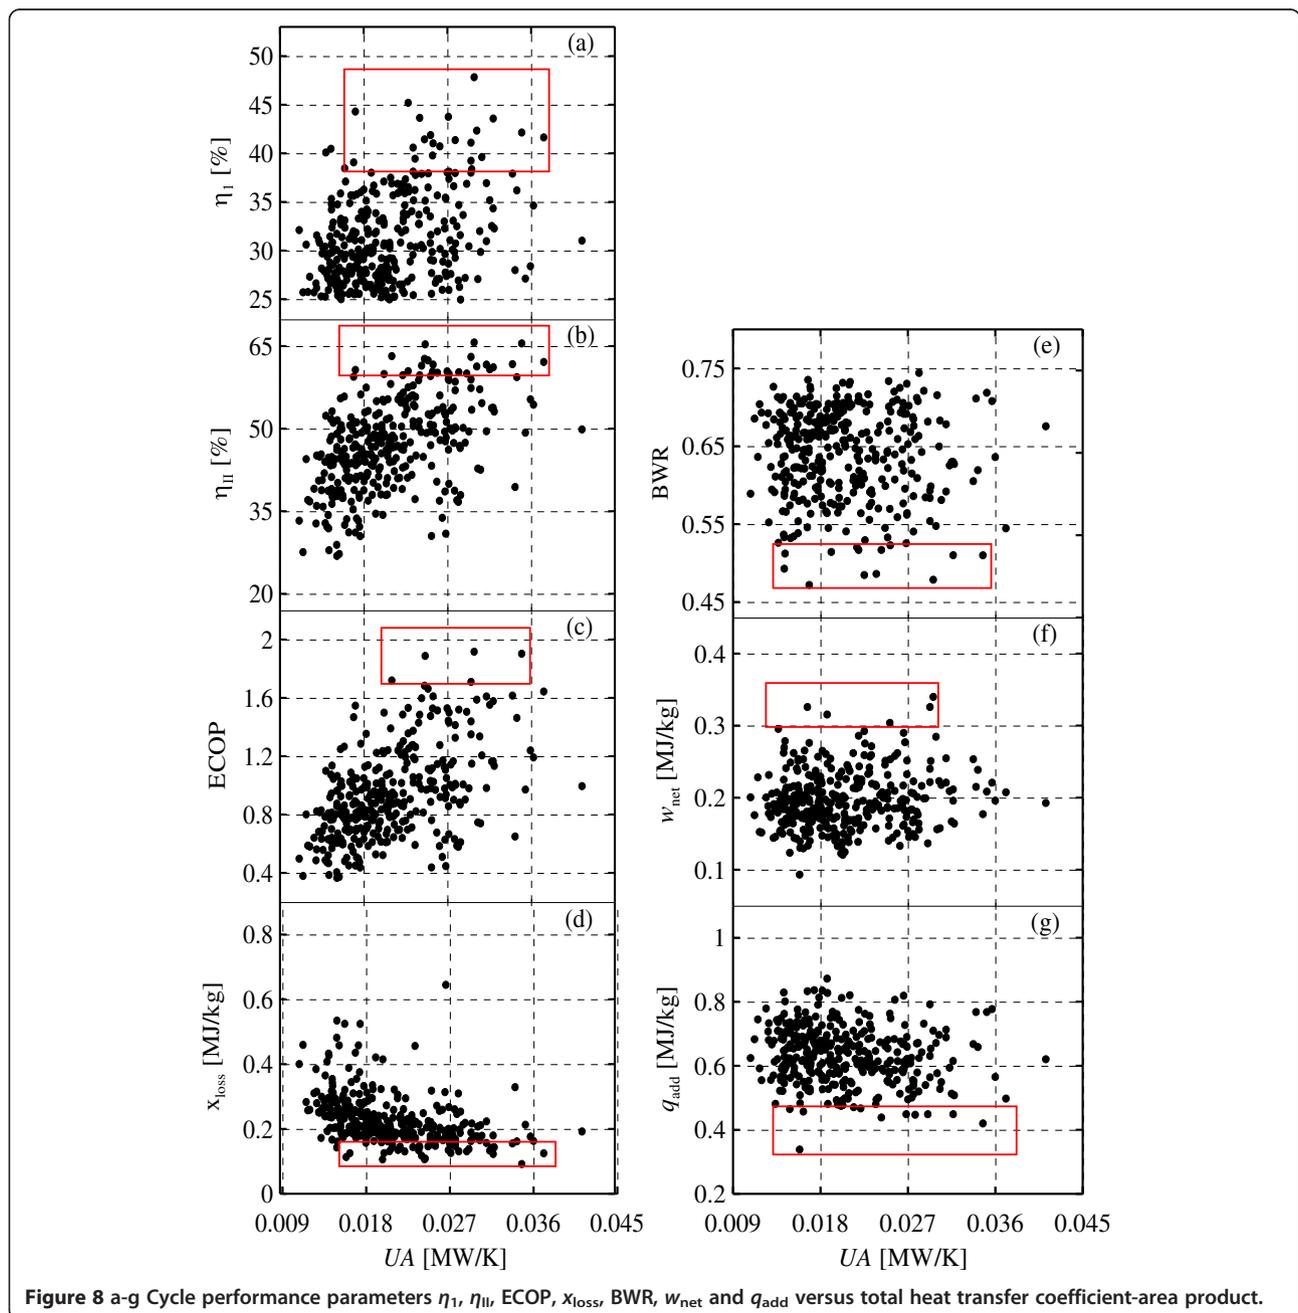

**Table 3 Simultaneously optimum operating design parameters to achieve optimum performance parameters of an irreversible gas turbine Brayton cycle**

Design parameters	Optimum range
Compressor inlet air temperature, $T_1$ , K	302 to 315
Maximum cycle temperature, $T_6$ , K	1,340 to 1,360
Maximum cycle pressure $P_4$ , kPa	1,440 to 2,830
Heat exchanger conductance, UA, kW/K	20.7 to 29.6

0.341 MJ/kg, and optimum  $q_{add}$  within 0.422 to 0.835 MJ/kg. In these figures, respectively, ranges of  $T_1$  are 301 to 412 K for  $\eta_{II} \geq 60\%$  and  $ECOP \geq 1.65$ , 302 to 417 K for  $x_{loss} \leq 0.150$  MJ/kg, 301 to 315 K for  $BWR \leq 0.525$ , 301 to 369 K for  $w_{net} \geq 0.300$  MJ/kg, and 302 to 352 K for  $q_{add} \leq 0.47$  MJ/kg. Effects of these ranges on other

performance parameters are listed in Table 2. Although the performance values of these parameters suffer some deteriorations outside the abovementioned ranges of  $T_1$ , yet, and except for BWR, their sensitivity towards  $T_1$  is not too critical. Variations of BWR show steep losses with the values of  $T_1$ .

**Sensitivity of cycle performance to maximum cycle temperature  $T_6$**

Compared to the almost unified range of  $T_1$  discussed above that produce optimum values of all the performance parameters, Figure 6a,b,c,d,e,f,g shows that  $T_6$  has drastically changed ranges depending on which performance parameter is to be optimized. Same optimum values of  $\eta_I$ ,  $\eta_{II}$ ,  $ECOP$ ,  $x_{loss}$ , BWR,  $w_{net}$  and  $q_{add}$  mentioned previously and listed in Table 2 require  $T_6$  to be in the ranges

**Table 4 Coefficient of least-square fitting of the data of each performance parameter with operating parameter**

		Polynomial coefficients $y = \sum_{i=0}^4 a_i x^i$					
		$a_0$	$a_1$	$a_2$	$R^2$	Range of y	Range of x
Effect of $T_1$ (K)	$\eta_I$ (%)	38.70743	0.14107	$-3.71733 \times 10^{-5}$	0.977	47.88% to 26.5%	307 to 448 K
	$\eta_{II}$ (%)	-10.80760	0.49830	$-8.11052 \times 10^{-5}$	0.99	56.76% to 50.21%	307 to 448 K
	ECOP	0.10328	0.01473	$-2.85902 \times 10^{-5}$	0.98	1.92 to 1.01	307 to 448 K
	$x_{loss}$ (kJ/kg)	38.7074	0.14107	-0.0003	0.97	47.88 to 26.5 kJ/kg	307.448 K
	BWR	-3.98656	0.02608	-0.0000373	0.99	0.5234 to 0.5758	311 to 345 K
	$w_{net}$ (kJ/kg)	4,098.474	22.73832	0.033916	0.95	285.2 to 326.5 kJ/kg	301 to 3,689 K
	$q_{in}$ (kJ/kg)	-768.6663	6.51454	-0.008414	0.85	440.1 to 500.3 kJ/kg	304 to 417 K
Effect of $T_6$ (K)	$\eta_I$ (%)	19.9733	0.11057	$5.18151 \times 10^{-6}$	0.88	40.64% to 47.88%	1,219 to 1,483 K
	$\eta_{II}$ (%)	-135.8492	0.286828	$-1.01925 \times 10^{-4}$	0.91	61.74% to 65.76%	1,213 to 1,483 K
	ECOP	-2.06871	$4.66995 \times 10^{-3}$	$-1.33033 \times 10^{-6}$	0.9	1.92 to 1.61	1,213 to 1,483 K
	$x_{loss}$ (kJ/kg)	$2.17010 \times 10^3$	-3.31852	$1.33394 \times 10^{-3}$	0.92	107.7 to 177.4 kJ/kg	1,021 to 1,483 K
	BWR	4.54487	$-6.027229 \times 10^{-3}$	$2.23556 \times 10^{-6}$	0.91	0.485 to 0.521	1,219 to 1,472 K
	$w_{net}$ (kJ/kg)	$-1.35172 \times 10^3$	2.1247	$-6.63125 \times 10^{-4}$	0.97	304.5 to 340.6 kJ/kg	1,338 to 1,483 K
	$q_{in}$ (kJ/kg)	593.0112	-0.69715	$4.44143 \times 10^{-4}$	0.93	340 to 499.2 kJ/kg	1,002 to 1,421 K
Effect of $P_4$ (MPa)	$\eta_I$ (%)	39.4442	$3.78362 \times 10^{-3}$	$-5.15619 \times 10^{-7}$	0.95	45.25% to 35.22%	0.75 to 8.32 MPa
	$\eta_{II}$ (%)	$-4.93274 \times 10^{-8}$	$-4.9076 \times 10^{-4}$	66.37495	0.95	65.76% to 60.49%	0.86 to 7.57 MPa
	ECOP	1.88093	$5.12392 \times 10^{-5}$	$-1.81698 \times 10^{-8}$	0.99	1.92 to 1.62	0.86 to 5.53 MPa
	$x_{loss}$ (kJ/kg)	$-4.04347 \times 10^{-7}$	0.015887	79.08315	0.99	163.2 to 93.3 kJ/kg	0.85 to 6.43 MPa
	BWR	$8.93573 \times 10^{-9}$	$-3.58163 \times 10^{-5}$	0.51752	0.96	0.537 to 0.479	0.923 to 4.41 MPa
	$w_{net}$ (kJ/kg)	$9.38396 \times 10^{-7}$	-0.0142	358.3297	0.99	340.5 to 304.5 kJ/kg	1.44 to 7.57 MPa
	$q_{in}$ (kJ/kg)	$2.47949 \times 10^{-6}$	0.01457	405.67103	0.99	502.5 to 421.5 kJ/kg	0.86 to 3.94 MPa
Effect UA (kW/K)	$\eta_I$ (%)	16.2101	2.39670	-0.04650	0.86	47.88% to 40.14%	13.61 to 37.04 kW/K
	$\eta_{II}$ (%)	32.70171	2.35327	-0.04146	0.9	65.76% to 60.78%	16.79 to 37.4 kW/K
	ECOP	-0.03198	0.13002	$-2.14243 \times 10^{-3}$	0.98	1.92 to 1.55	16.79 to 34.67 kW/K
	$x_{loss}$ (kJ/kg)	0.10875	-5.16757	168.692	0.99	126.4 to 107.7 kJ/kg	15.8 to 37.04 kW/K
	BWR	$4.35305 \times 10^{-4}$	-0.0201	0.68964	0.98	0.545 to 0.473	14.22 to 37.04 kW/K
	$w_{net}$ (kJ/kg)	-0.23225	12.10661	178.35128	0.73	340.6 to 30.1 kJ/kg	13.6 to 29.56 kW/K
	$q_{in}$ (kJ/kg)	0.33363	-16.06035	6.33.8598	0.94	399.2 to 440.1 kJ/kg	13.31 to 26.78 kW/K

1,220 to 1,480 K, 1,200 to 1,480 K, 1,220 to 1,480 K, 1,000 to 1,420 K, 1,220 to 1,480 K, 1,340 to 1,460 K, and 1,000 to 1,380 K, respectively. These values are generally expected since the higher is the  $T_6$ , the better  $\eta_I$ ,  $\eta_{II}$ , ECOP, and  $w_{net}$ . Optimum values of the other two performance parameters, i.e.,  $x_{loss}$  and  $q_{add}$ , necessitate that  $T_6$  must be low in the range 1,000 to 1,380 K. In regards to sensitivity, and except for  $x_{loss}$  and  $q_{add}$  which are less sensitive to  $T_6$ , all other performance parameters exhibit great sensitivity to  $T_6$ , where their values greatly deteriorate outside the abovementioned optimum ranges of  $T_6$ . The wide ranges of  $T_6$  mentioned above for optimum performance are in favor of the practical application of the cycle, which signifies that the cycle can accommodate any minor deterioration of the cycle components that are dependent on this high temperature. It is worthy to mention here that the material selection of the cycle components that are exposed to this high cycle temperature will put further restrictions and some adjustments to make these ranges practically appropriate.

#### Sensitivity of cycle performance to maximum cycle pressure $P_4$

The effects of maximum pressure  $P_4$  on optimum performance are shown in Figure 7a,b,c,d,e,f,g. Optimum values of  $\eta_I$ ,  $\eta_{II}$ , ECOP,  $x_{loss}$ , BWR,  $w_{net}$ , and  $q_{add}$  require  $P_4$  to be in the ranges 0.75 to 7.57 MPa, 0.75 to 7.57 MPa, 0.864 to 4.49 MPa, 0.75 to 4.49 MPa, 0.864 to 4.03 MPa, 1.44 to 7.57 MPa, and 0.864 to 2.830 MPa, respectively. In contrast to  $T_6$ , the lower the  $P_4$ , the better the cycle is. Optimum exergy loss and heat added to the cycle necessitate that  $P_4$  must be low (i.e., in the range of 0.864 to 2.830 MPa, Figure 7d,g) to result in less losses and less amount of heat added. Although all performance parameters show different degrees of sensitivity to the value of  $P_4$ , where they show some deterioration outside the abovementioned optimum ranges of the pressure, yet  $w_{net}$  has the least sensitivity. Although pressure values up to 12 MPa have been used in the MCM, the maximum value that results in optimum value of any of the performance parameters never exceeds 7.57 MPa, which is greatly in favor of practical applications of the cycle. Again, material selections of components that are exposed to this high pressure may have some limitations imposed by their stress requirement and pumping losses.

#### Sensitivity of cycle performance to heat exchanger's conductance UA

The heat exchanger's conductance, defined as the product of overall heat transfer coefficient and surface area of the heat exchanger ( $UA = \dot{Q}_{add}/\Delta T_m$ ), is considered an important operating/design parameter that is to be optimized based on the first law of thermodynamics and

cost analysis. The selection of an optimum range for UA of heat exchangers is illustrated in Figure 8a,b,c,d. Optimum values of  $\eta_I$ ,  $\eta_{II}$ , ECOP,  $x_{loss}$ , BWR,  $w_{net}$ , and  $q_{add}$  require UA to be in the ranges 13.6 to 37 kW/K, 16.8 to 37 kW/K, 20.7 to 34.7 kW/K, 14.8 to 37 kW/K, 14.2 to 34.7 kW/K, 16.6 to 29.6 kW/K, and 13.6 to 34.7 kW/K, respectively. All optimum cycle performance parameters require almost the same wide range of UA which is considered in favor of the cycle practical use. Although among the performance parameters, only ECOP and  $w_{net}$  show higher sensitivity with UA, where their values deteriorate very much outside their respective optimum ranges of UA, yet the non-sensitivity of the other performance parameters with UA is considered another positive point from a practical point of view.

#### Unified operating ranges for simultaneous optimum performance

Table 3 shows the unified ranges of the operating parameters that give simultaneous optimum performance (maximum  $\eta_I$ ,  $\eta_{II}$ , ECOP,  $w_{net}$ ,  $x_{loss}$ , BWR,  $q_{add}$ ) for the cycle. Inspection of the ranges discussed in the above sections leads to the conclusion that there are some unified ranges of the operating parameters that simultaneously optimize all the performance parameters. These ranges are as follows:  $T_1$  (302 to 315 K),  $T_6$  (1,340 to 1,360 K),  $P_4$  (1.440 to 2.830 MPa), and UA (20.7 to 29.6 kW/K). Although the unified ranges for both  $T_1$  and  $T_6$  are very narrow, which might represent some restrictions, the good design of the components of the cycle can cope with these narrow ranges.

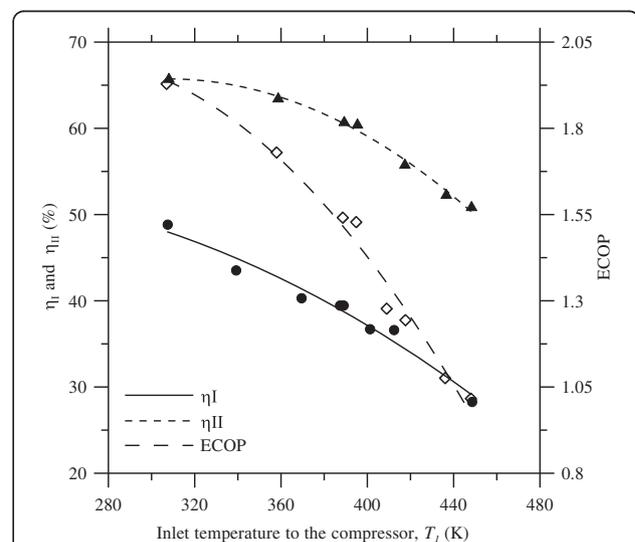


Figure 9 Optimum MCM results of  $\eta_I$ ,  $\eta_{II}$ , and ECOP and their fitted equations w.r.t.  $T_1$ . With ranges of other operating parameter values as in Table 1.

### Generalized optimal performance equations

From the MCM results and their representative figures discussed above, least-square fitting of the data of each performance parameter with each operating parameter, that only lie on the optimum envelop (i.e., maximum or minimum), gives the following equations together with their regression coefficients  $R^2$  and the respective ranges of its application. These equations are displayed in Table 4. Figure 9 exemplifies one set of the fitted equations (i.e., optimal  $\eta_I$ ,  $\eta_{II}$ , and ECOP versus  $T_1$ ). Effects of  $T_1$ ,  $T_6$ ,  $P_4$ , and UA on each performance parameter is shown in Table 4.

The set of equations displayed in Table 4 can form a good basis for designing an optimal cycle, where the effect of each of the operating parameters on each of the performance parameters has been exclusively demonstrated in this mathematical form along with the applicable ranges of these two parameters regardless of the values of the other parameters. It is worthy to mention that the above equations are the result of a survey that concurrently covers all the practical ranges of the operating parameters, which can be easily understood to be the global optimal representation of the performance of the cycle. Also, the results discussed above are generally applicable to the cycle and are not restricted to some specific values of operating parameters or conditions of operation.

### Conclusions

The present study has developed a general mathematical model to specify the performance as dependent on design and operating parameters of an irreversible gas turbine Brayton cycle incorporating two-stage compressor, two-stage gas turbine, intercooler, reheater, and regenerator with irreversibilities due to finite heat transfer rates and pressure drops. Ranges of operating parameters resulting in optimum performance (i.e.,  $\eta_I \geq 38\%$ ,  $\eta_{II} \geq 60\%$ , ECOP  $\geq 1.65$ ,  $x_{\text{loss}} \leq 0.150$  MJ/kg, BWR  $\leq 0.525$ ,  $w_{\text{net}} \geq 0.300$  MJ/kg, and  $q_{\text{add}} \leq 0.470$  MJ/kg) are determined and discussed using the Monte Carlo method. These operating ranges are as follows: minimum cycle temperature ranges between 302 and 315 K, maximum cycle temperature ranges between 1,320 and 1360 K, maximum cycle pressure ranges between 1.449 and 2.830 MPa, and conductance of the heat exchanger ranges between 20.7 and 29.6 kW/K. The exclusive effect of each of the operating parameters on each of the performance parameters is mathematically given in a general sense that is applicable regardless of the values of the rest of the operating parameters and under any condition of operation of the cycle.

### Notations

$a$  surface area  
BWR back work ratio

$\dot{C}$  heat capacity rate  
 $C^*$  heat capacity ratio  
ECOP ecological coefficient of performance  
 $h$  enthalpy  
 $\dot{m}$  mass flow rate  
NTU number of transfer units  
 $P$  pressure  
 $\dot{Q}$  heat rate  
 $q$  heat flux  
 $R$  gas constant  
 $s$  specific entropy  
 $T$  temperature  
UA conductance  
 $\dot{W}$  power  
 $w$  work  
 $x$  exergy  
 $\varepsilon$  effectiveness  
 $\eta$  efficiency

### Subscripts

0 dead state  
add high temperature heat addition  
bur burner  
c cold fluid, compressor  
dest destruction  
I first law  
II second law  
int intercooler  
max maximum  
reg regenerator  
reh reheater  
rej rejected  
t turbine

### Competing interests

The authors declare that they have no competing interests.

### Authors' contributions

MMAAS conceived the concept and procedures of the present work, developed the model, carried out the analysis of the results, and wrote the manuscript. KKM checked the equations and analysis and reviewed the manuscript. YMAR developed the model, carried out the computations, and reviewed the manuscript. All authors read and approved the final manuscript.

### Authors' information

Maher M Abou Al-Sood earned his Ph.D. degree in Mechanical Engineering from the University of Manitoba, Canada, in 2007. He is currently an assistant professor in the Department of Mechanical Engineering at the Assiut University, Egypt. He has been interested in heat and mass transfer relating to droplets and spray modeling, turbulence, combustion, and modeling and simulation of internal combustion engines. Kassem K Matrawy received his Ph.D. degree in Mechanical Engineering from Czech Technical University in Prague, Czech, in 1994. He has been interested in renewable energy. Yousef M Abdel-Rahim received his Ph.D. degree in Mechanical Engineering from Kansas State University, USA, in 1984. Now, he is an emeritus professor in the Department of Mechanical Engineering at the Assiut University, Egypt. His research interests focus on combustion and management and optimization of thermal systems.

#### Acknowledgment

This work has been fully supported by the Assiut University and the Mechanical Engineering Department.

Received: 24 March 2013 Accepted: 12 August 2013  
Published: 26 September 2013

#### References

1. Kaushik, SC, Tyagi, SK: Finite time thermodynamic analysis of a nonisentropic regenerative Brayton heat engine. *Int. J. Sol. Energy* **22**, 141–151 (2002)
2. Rahman, MM, Ibrahim, TK, Taib, MY, Noor, MM, Bakar, RA: Thermal analysis of open-cycle regenerator gas-turbine power-plant. *World Academy of Science Eng Technol* **44**, 1307–13012 (2010)
3. Vecchiarelli, J, Kawall, JG, Wallace, JS: Analysis of a concept for increasing the efficiency of a Brayton cycle via isothermal heat addition. *Int. J. Energy Res* **2**, 113–127 (1997)
4. Göktun, S, Yavuz, H: Thermal efficiency of a regenerative Brayton cycle with isothermal heat addition. *Energy Convers. Manage* **40**, 1259–1266 (1999)
5. Erbay, LB, Göktun, S, Yavuz, H: Optimal design of the regenerative gas turbine engine with isothermal heat addition. *Appl. Energy* **68**, 249–269 (2001)
6. Kaushik, SC, Tyagi, SK, Singhal, MK: Parametric study of an irreversible regenerative Brayton heat engine with isothermal heat addition. *Energy Convers. Manage* **44**, 2013–2025 (2003)
7. Cheng, CY, Chen, CK: Maximum power of an endoreversible intercooled Brayton cycle. *Int. J. Energy Res* **24**, 485–49 (2000)
8. Canie're, H, Willockx, A, Dick, E, Paeppe, MD: Raising cycle efficiency by intercooling in air-cooled gas turbines. *Appl Therm Eng* **26**, 1780–1787 (2006)
9. Negridi, MG, Gambini, M, Peretto, A: Reheat and regenerative gas turbine for feed water repowering of steam power plant. *ASME Turbo Expo*, Houston (1995)
10. Khaliq, A, Kaushik, SC: Thermodynamic performance evaluation of combustion gas turbine cogeneration system with reheat. *Appl Therm Eng* **24**, 1785–1795 (2004)
11. Hernández, C, Roco, JMM, Medina, A: Power and efficiency in a regenerative gas-turbine with multiple reheating and intercooling stages. *J. Phys. D: Appl. Phys* **29**, 1462–1468 (1996)
12. Sogut, OS, Ust, Y, Sahin, B: The effects of intercooling and regeneration on the thermo-ecological performance analysis of an irreversible-closed Brayton heat engine with variable temperature thermal reservoirs. *J. Phys. D: Appl. Phys* **39**, 4713–4721 (2006)
13. Tyagi, SK, Chen, GM, Wang, Q, Kaushik, SC: Thermodynamic analysis and parametric study of an irreversible regenerative-intercooled-reheat Brayton cycle. *Int J Therm Sci* **40**, 829–840 (2006)
14. Wang, W, Chen, L, Sun, F, Wu, C: Performance analysis of an irreversible variable temperature heat reservoir closed intercooled regenerated Brayton cycle. *Energy Convers. Manage* **44**, 2713–2732 (2003)
15. Sánchez-Ortiz, S, Medina, A, Hernández, AC: Thermodynamic model and optimization of a multi-step irreversible Brayton cycle. *Int J Therm Sci* **51**, 2134–2143 (2010)
16. Herrera, A, Sandoval, JA, Rosillo, ME: Power and entropy generation of an extended irreversible Brayton cycle: optimal parameters and performance. *J. Phys. D: Appl. Phys* **39**, 3414–3424 (2006)
17. Landsberg, PT, Leff, HS: Thermodynamic cycles with nearly universal maximum-work efficiencies. *J. Phys. A: Mathematical and General* **22**, 4019–4026 (1989)
18. Aragón-González, G, Canales-Palma, A, León-Galicia, A: Maximum irreversible work and efficiency in power cycles. *J. Phys. D: Appl. Phys* **33**, 1403–1409 (2000)
19. Roco, JMM, Velasco, S, Medina, A, Hernandez, AC: Optimum performance of a regenerative Brayton thermal cycle. *J Appl Phys* **82**, 2735–2741 (1997)
20. Wu, C, Chen, L, Sun, F: Performance of a regenerative Brayton heat engine. *Energy* **21**, 71–76 (1996)
21. Ibrahim, TK, Rahman, MM: Effects of operation conditions on performance of a gas turbine power plant. In: *National Conference in Mechanical Engineering Research and Postgraduate Studies (2nd NCMER 2010)*, pp. 135–144. Faculty of Mechanical Engineering, UMP Pekan, Kuantan (2010)
22. Ali Mousafarash, A, Ameri, M: Exergy and exergo-economic based analysis of a gas turbine power generation system. *Journal of Power Technologies* **93**, 44–51 (2013)
23. Medina, A, Roco, JMM, Hernandez, AC: Regenerative gas turbines at maximum power density conditions. *J. Phys. D: Appl. Phys* **29**, 2802–2805 (1996)
24. Chen, L, Zheng, J, Sun, F, Wu, C: Performance comparison of an irreversible closed Brayton cycle under maximum power density and maximum power conditions. *Exergy, an International Journal* **2**, 345–351 (2002)
25. Al-Hadhrami, LM, Shaahid, SM, Al-Mubarak, AA: Jet impingement cooling in gas turbines for thermal efficiency and power density. In: Ernesto, B. (ed.) *Advances in Gas Turbine Technology*, pp. 191–210. InTech, New York (2011). ISBN 978-953-307-611-9
26. Hernández, AC, Medina, A, Roco, JMM: Power and efficiency in a regenerative gas turbine. *J. Phys. D: Appl. Phys* **28**, 2020–2023 (1995)
27. Li, Y, Huang, Y, Yan, X: The effects of variable specific heats of working fluid on the performance of irreversible reciprocating Brayton cycle. *Advanced Materials Research* **345–355**, 1305–1310 (2012)
28. Stevens, T, Baelmans, M: Optimal pressure drop ratio for micro recuperators in small sized gas turbines. *Appl Therm Eng* **28**, 2353–2359 (2008)
29. Farzaneh-Gord, M, Deymi-Dashtebayaz, M: Effect of various inlet air cooling methods on gas turbine performance. *Energy* **36**, 1196–1205 (2011)
30. De Sa, A, Al Zubaidy, SA: Gas turbine at varying ambient temperature. *Appl Therm Eng* **31**, 2735–2739 (2011)
31. Sayyaadi, H, Reza Mehrabipour, R: Efficiency enhancement of a gas turbine cycle using an optimized tubular recuperative heat exchanger. *Energy* **38**, 362–375 (2012)
32. Ahmadi, P, Dincer, I: Thermodynamic and exergoenvironmental analysis and multi-objective optimization of a gas turbine power plant. *Appl Therm Eng* **31**, 2529–2540 (2011)
33. Haseli, Y: Optimization of a regenerative Brayton cycle by maximization of a newly defined second law efficiency. *Energy Convers. Manage* **68**, 113–140 (2013)
34. Cengel, YA, Boles, MA: *Thermodynamics: An engineering Approach*, 7th edn. McGraw Hill, New York (2010)
35. Shah, RK, Sekulic, DP: *Fundamentals of Heat Exchanger design*. Wiley, New York (2003)
36. Ust, Y, Sahin, B, Kodal, A, Akcay, IH: Ecological coefficient of performance analysis and optimization of an irreversible regenerative-Brayton heat engine. *Appl. Energy* **83**, 558–572 (2006)
37. Ust, Y, Sahin, B, Kodal, A: Performance analysis of an irreversible heat engine base on ecological coefficient of performance criterion. *Brayton heat engine. Int. J. Therm. Sci* **45**, 94–101 (2006)

doi:10.1186/2251-6832-4-37

Cite this article as: Al-Sood et al.: Optimum parametric performance characterization of an irreversible gas turbine Brayton cycle. *International Journal of Energy and Environmental Engineering* 2013 **4**:37.

Submit your manuscript to a SpringerOpen<sup>®</sup> journal and benefit from:

- Convenient online submission
- Rigorous peer review
- Immediate publication on acceptance
- Open access: articles freely available online
- High visibility within the field
- Retaining the copyright to your article

Submit your next manuscript at ► [springeropen.com](http://springeropen.com)